

Schedule of Door & Windows				
Name	Lintel	Width	Sill lvl	Description
D1	2.10	0.90	-	PVC DOOR
D2	2.10	0.75	-	
W1	2.10	2.00	0.90	
W2	2.10	1.50	0.90	
W3	2.10	1.40	1.20	
V	2.10	0.60	1.65	

NOTES:-
 Clear height of DU = 2.85 m
 Earthquake resistance structure as per site condition
 * All the Dimensions in m


Vinayak
 Assistant Professor
 Department of Civil Engineering
 National Institute of Technology
 Hamirpur - 177005 (H.P.)

NOTES:-

- All dimensions are in m, unless wherever specified diameter of the bars shown in mm
- Dimensions are not to be scaled out, only written dimensions may be taken as correct.
- Nominal mix concrete 1:1.5:3 according IS 456 Clause 9.3
- The reinforcement shall be of high strength deformed steel bars conforming to IS:1786-2008
- Lap length and development length (L_d) for 8mmφ is 400 mm
- Second class brick must be used
- Mortar 1:5 according to Table 3 IS 4326-2013
- All walls are one Brick Thick Masonry walls or Autoclaved Aerated Block of Class 7.5
- Any discrepancy in the structural drawings should be correlated with architectural drawing.
- Refer DWG-2 to DWG-5 for earthquake resistance and structural detail.

DRG. No. - NIT/CEd/2017/PMAY-OP2-RCC-FR-V/DWG-1
NATIONAL INSTITUTE OF TECHNOLOGY HAMIRPUR
BUILDING NAME: PMAY HEA OPTION 2
RCC BUILDING FLAT ROOF ZONE V
DRAWING TITLE: FLOOR PLAN
DESIGNED BY: Dr. Pardeep Kumar
Dr. Hemant Kumar Vinayak

Dr. Pardeep Kumar
 Associate Professor (Structural Engg)
 Civil Engineering Department
 NIT, Hamirpur (H.P.)-177005

Sl. No.	Column	Transverse reinforcement	Sectional plan with longitudinal reinf. Footing to/roof level
1.	C1	8Ø @ 100mm C/C "A" 8Ø @ 150mm C/C "B"	
All Column Size are 35cm x 35cm and Grade is M20			



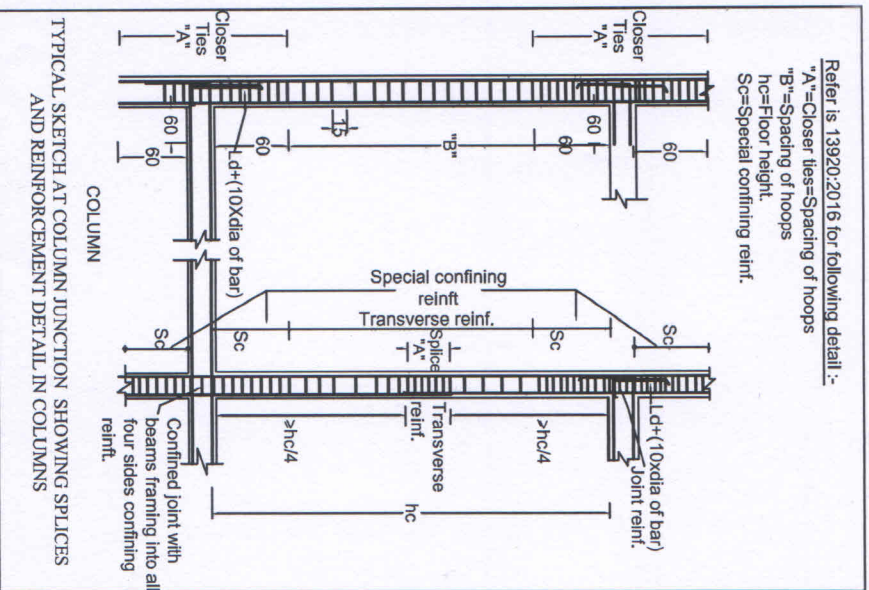


CHART SHOWING DETAIL OF ISOLATED FOOTING REINFORCEMENT

Sr. No.	Name of footing	Size of column (bxd)	Size of footing (BXD)	Size of pit (B1XD1)	Thickness of footing T2	d-eff.	h	Spacing of reinf. parallel to x-x	Spacing of reinf. parallel to y-y
1.	F1	35 X 35	135 X 135	145 X 145	30	25	20	8Ø @ 175mm C/C	8Ø @ 175mm C/C

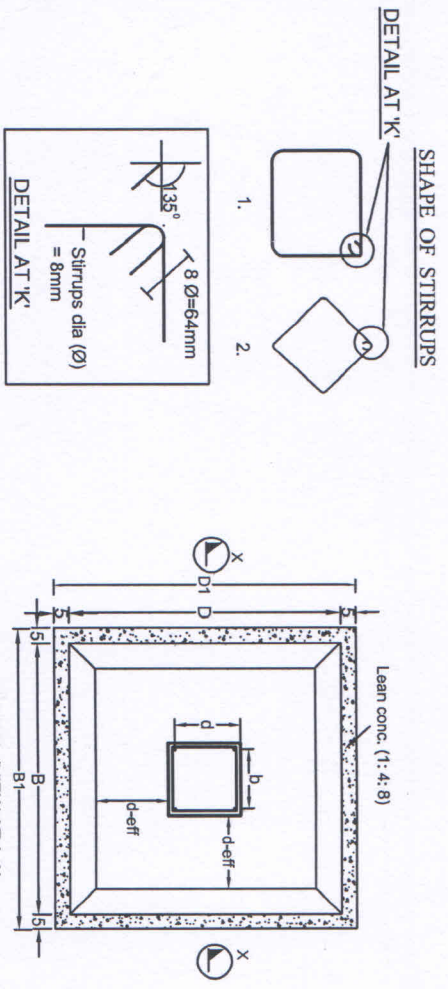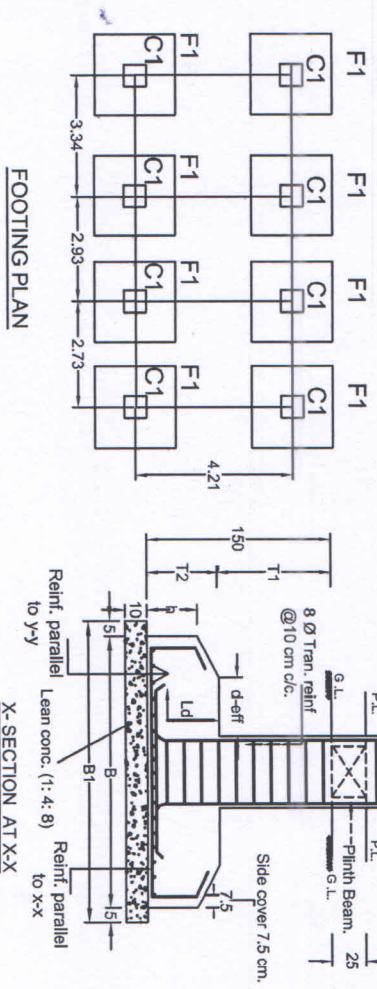

NOTES:-

- All dimensions are in cm unless wherever specified diameter of the bars shown in mm.
- Dimensions are not to be scaled out, only written dimensions may be taken as correct.
- Safe bearing capacity for design of footing is considered at 15 T/m² to be ensured at site.
- Grade of concrete M20.
- The reinforcement shall be of high strength deformed steel bars conforming to IS:1786-2008.
- Minimum clear cover to the reinforcement including stirrups:-
 - (i) Beam 25 mm
 - (ii) Column 40 mm
 - (iii) Footing 50 mm
- Lap length and development length (L_d)
 - (i) For 16 mm Ø = 800
 - (ii) For 12 mm Ø = 600
 - (iii) for 8 mm Ø = 400
- The concrete shall be mechanically mixed and vibrated with water- cement ratio not exceeding 0.55.
- Incase the proposed building is at probable landslide prone area the soil should be retained properly with adequate retaining wall to prevent differential settlement of the foundation.
- Any discrepancy in the structural drawing should be correlated with architectural drawing

DRG. No. - NIT/CED/2017/DP-2-RCC-FR Z/V/DWG-2

NATIONAL INSTITUTE OF TECHNOLOGY HAMIRPUR

BUILDING NAME: PMAY HFA OPTION 2

REINFORCED CONCRETE BUILDING FLAT ROOF ZONE V



DETAIL OF FOOTINGS & COLUMN

Hemant Kumar Vinayak
 Dr. Hemant Kumar Vinayak
 Assistant Professor
 Department of Civil Engineering
 National Institute of Technology,
 Hamirpur - 177005 (H.P.)


Pardeep Kumar
 Dr. Pardeep Kumar
 Associate Professor (Structural Engg.)
 Civil Engineering Department
 NIT, Hamirpur (H.P.)-177005

DETAILED DRAWING OF REINFORCEMENT OF BEAMS AT PLINTH LEVEL


S - 8 mm dia bars @ 100 mm c/c

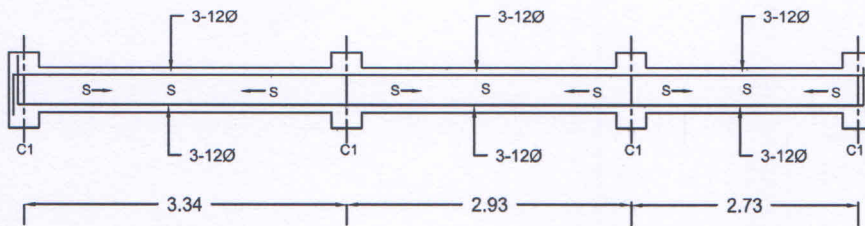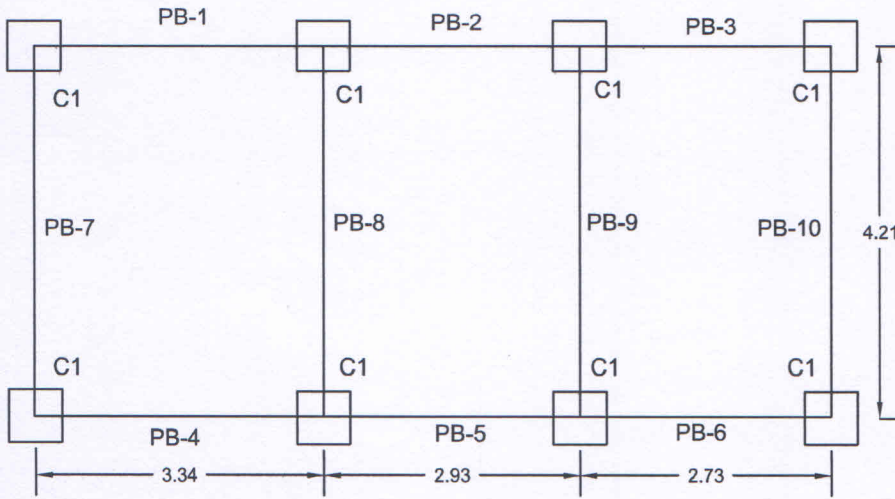

BEAM DETAIL FOR BEAM PB-1 to PB-6

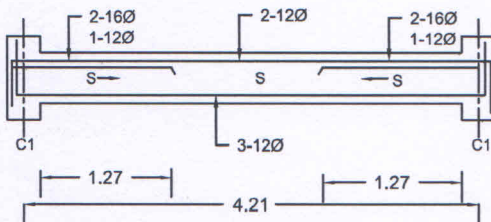

BEAM DETAIL FOR BEAM PB-7 & PB-10

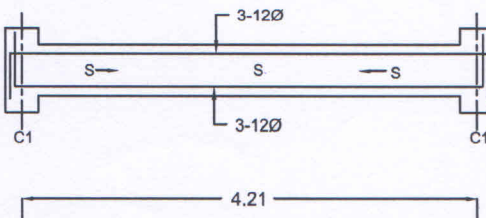

BEAM DETAIL FOR BEAM PB-8 & PB-9

NOTES :

- All dimensions are in meters, unless wherever specified diameter of the bars shown in mm.
- Dimensions are not to be scaled out, only written dimensions may be taken as correct.
- Size of Beam is 250 X 250 mm.
- Grade of concrete shall be M20.
- All reinforcement shall be of grade Fe 415 conforming to IS:1786-2008.
- Clear Cover to reinforcement shall be 25 mm.
- Bending and fixing of reinforcement shall be as per IS:2502-1963.
- Lap length and anchorage length shall be 57 times the bar diameter
- Further refer notes from the drawing of 'Detail' of footings'.

DRG. No. - NIT/CED/2017/OP-2-RCC-FR Z-V/DWG-3

**NATIONAL INSTITUTE OF
TECHNOLOGY HAMIRPUR**

**BUILDING NAME :
PMAY HFA
OPTION 2
REINFORCED CONCRETE
BUILDING
FLAT ROOF
ZONE V**

DETAIL OF PLINTH BEAM



**DESIGNED BY:
Dr. Pardeep Kumar
Dr. Hemant Kumar Vinayak**

Hemant
Dr. Hemant Kumar Vinayak
Assistant Professor
Department of Civil Engineering
National Institute of Technology,
Hamirpur -177005 (H.P.)


Pardeep
Dr. Pardeep Kumar
Associate Professor (Structural Engg.)
Civil Engineering Department
NIT, Hamirpur (H.P.)-177005

DETAILED DRAWING OF REINFORCEMENT OF BEAMS AT ROOF LEVEL

S - 8 mm dia bars @ 100 mm c/c

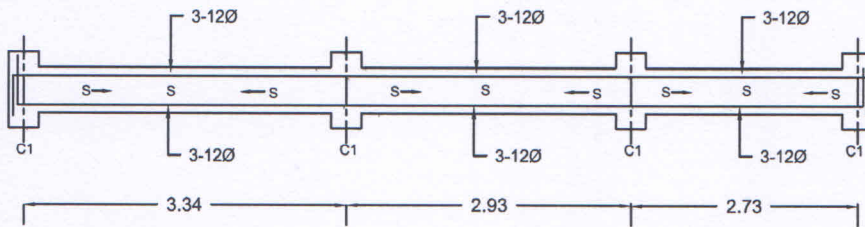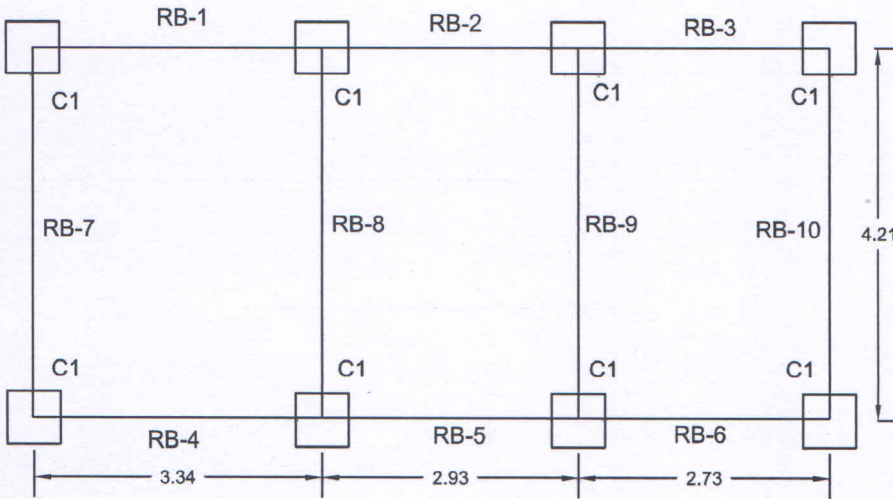

BEAM DETAIL FOR BEAM RB-1 to RB-6

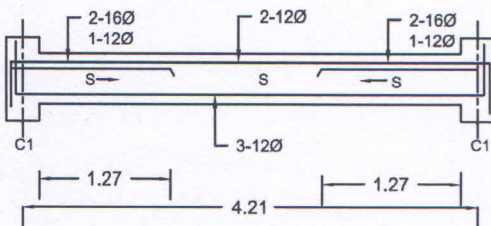

BEAM DETAIL FOR BEAM RB-7 TO RB-10

NOTES :

- All dimensions are in meters, unless wherever specified diameter of the bars shown in mm.
- Dimensions are not to be scaled out, only written dimensions may be taken as correct.
- Size of Beam is 250 X 250 mm.
- Grade of concrete shall be M20.
- All reinforcement shall be of grade Fe 415 conforming to IS:1786-2008.
- Clear Cover to reinforcement shall be 25 mm.
- Bending and fixing of reinforcement shall be as per IS:2502-1963.
- Lap length and anchorage length shall be 57 times the bar diameter
- Further refer notes from the drawing of 'Detail' of footings'.

DRG. No. - NIT/CED/2017/OP-2-RCC-FR Z-V/DWG-4

**NATIONAL INSTITUTE OF
TECHNOLOGY HAMIRPUR**


**BUILDING NAME :
PMAY HFA
OPTION 2
REINFORCED CONCRETE
BUILDING
FLAT ROOF
ZONE V**

DETAIL OF ROOF BEAM


**DESIGNED BY:
Dr. Pardeep Kumar
Dr. Hemant Kumar Vinayak**

Hemant Vinayak
Dr. Hemant Kumar Vinayak
Assistant Professor
Department of Civil Engineering
National Institute of Technology,
Hamirpur -177005 (H.P.)


Pardeep Kumar
Dr. Pardeep Kumar
Associate Professor (Structural Engg.)
Civil Engineering Department
NIT, Hamirpur (H.P.)-177005

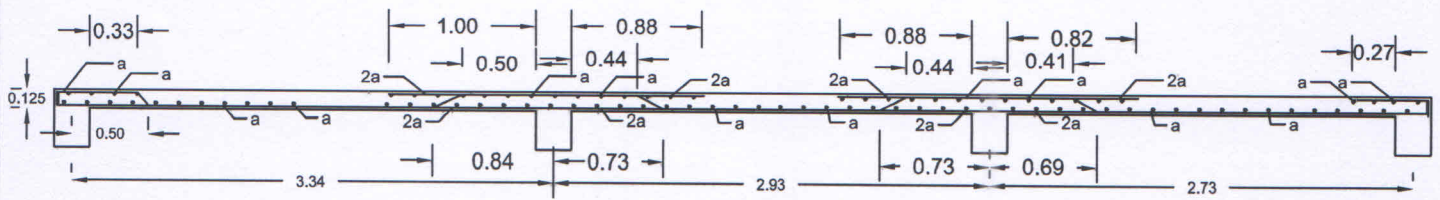


Section 1-1

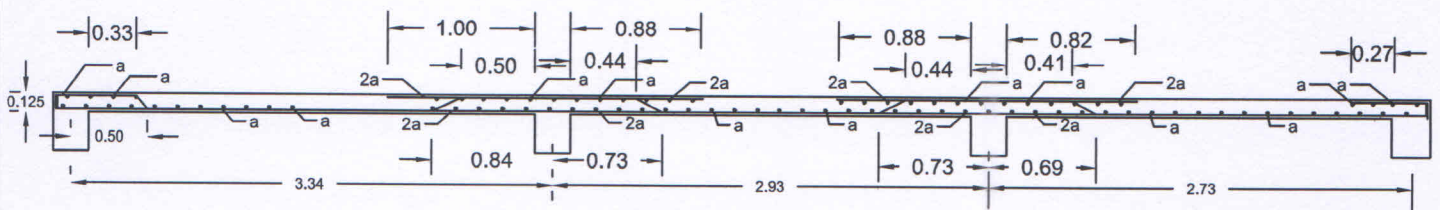

Section 2-2

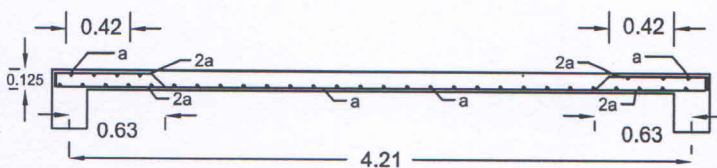

Section 3-3

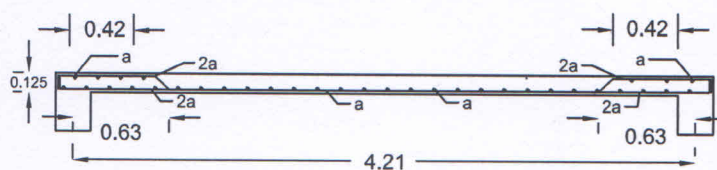

Section 4-4

- Clear cover for the slab should be 20mm.
- All dimensions are in meter

SCHEDULE OF BARS

a. 8 mm Ø @ 150 mm c/c

DRG. No. - NIT/CED/2017/PMAY
-OP2-RCC-FR-ZV/DWG-5

NATIONAL INSTITUTE OF
TECHNOLOGY HAMIRPUR

BUILDING NAME:
PMAY HFA
OPTION 2
REINFORCED CONCRETE
BUILDING
FLAT ROOF
ZONE V

DRAWING TITLE:
SLAB DETAILS

DESIGNED BY:
Dr. Pardeep Kumar
Dr. Hemant Kumar Vinayak

Hemant Kumar Vinayak
Dr. Hemant Kumar Vinayak
Assistant Professor
Department of Civil Engineering
National Institute of Technology,
Hamirpur -177005 (H.P.)

Pardeep Kumar
Dr. Pardeep Kumar
Associate Professor (Structural Engg.)
Civil Engineering Department
NIT, Hamirpur (H.P.)-177005